


EXTINGUISHANT CONTROL PANEL



PRODUCT OVERVIEW

- Designed and manufactured to the highest standards in a quality controlled environment and with UL & FM approvals, the Shield A-XT releasing panel offers outstanding value and performance for all small to medium fixed firefighting installations
- With three detection zones as standard, extinguishant release can be configured to activate from any combination of detection zone inputs to allow (among other combinations) any two from three type activations such as would be required for detection in ceiling void, room and floor void applications.
- The extensive configuration options of the Shield A-XT allow the functionality of the system to be extensively modified.
- The panel contains a large LED display to enable easy configuration and control which also displays the time remaining until extinguishant release for added user safety.
- The countdown timer is duplicated on up to seven remote status units to provide local indication of the system status.
- With all of the electronics mounted on a single, easily removable, steel plate Shield A-XT panels are both robust and easy to install.
- Shield A-XT is supplied in an enclosure that matches the design and colour of the elite RS range and is available in standard red or optional grey.

PRODUCT INFORMATION

Shield A-XT is a new generation extinguishant releasing panel which is UL, FM listed. The simple, programmable configuration options and easy to install construction make Shield A-XT panels the ideal choice for small to medium sized systems using all extinguishant agents.


FEATURES

- UL864 and FM listed
- Three initiation circuits as standard
- Any single zone or any combinations of zones can be configured to release
- Configurable first stage NAC delays
- Configurable detection delays
- Zero time delay upon manual release option
- Compatible with I.S. barriers
- Non-latching zone input option to receive signals from other systems such as aspirating equipment
- Configurable extinguishant delays up to 60 seconds in 5 second steps
- Configurable extinguishant duration up to 5 minutes in 5 second steps
- Countdown timer shows time remaining until release
- Supports up to seven, four wire status indicators
- Built in Extract Fan control

PROGRAMMABLE FUNCTIONS

Access Level 2	Access Level 3
<ul style="list-style-type: none"> Test Zones 1 to 3 Disable Zones 1 to 3 Disable 1st Stage Alarms Disable Pre-activated 1st Stage Relay Disable Pre-activated 2nd Stage Relay Disable Extract Fan Output Disable Manual Release Input Disable Extinguishant Sub System Activate Extract Fan Output Activate Alarm Delays 	<ul style="list-style-type: none"> Sounder Delay Coincidence Detection Disable Panel Features Zone Alarm Delays (Detectors) Zone Alarm Delay (Call Points) Configure Zone for I.S Barrier Use Zone Short Circuit Alarm Zone Non Latching Zone Inputs Delay Extinguishant Release Time Delay Extinguishant Release Duration Timer Extinguishant Reset Delay Timer

DIAGRAM

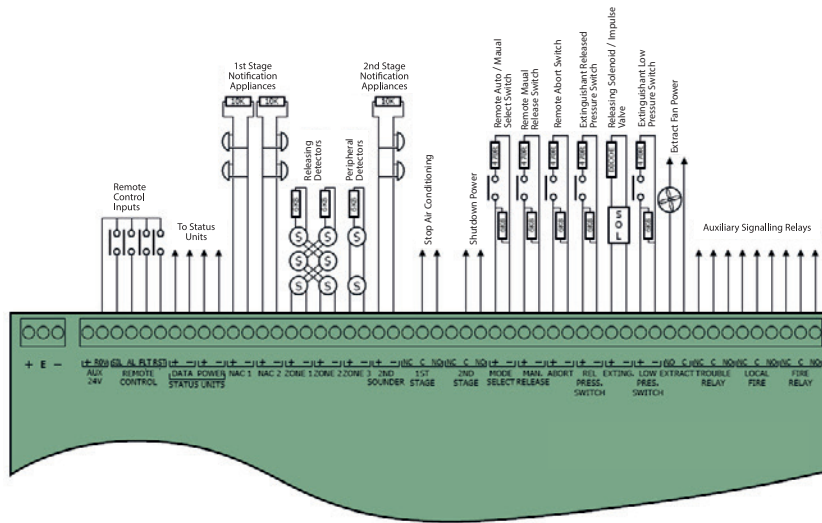

TECHNICAL DATA

Construction	1.2mm mild sheet steel
IP Rating	IP30
Finish	Epoxy powder coated
Colour - lid & box	Red RAL 3002 (optional grey BS 00 A 05 semi-matt)
Mains supply	230V AC or 115V AC
Mains supply fuse	1.6 Amp (F1.6A L250V)
Power supply rating	3 Amps total including battery charge 28V +/- 2V
Maximum ripple current	200 millivolts
Battery type (Yuasa NP)	Two 12 Volt 7Ah sealed lead acid in series
Battery charge voltage	27.6VDC nominal (temperature compensated)
Battery charge current	0.7A maximum
Battery fuse	20mm, 3.15A glass
Maximum current draw from batteries	3 Amps
Quiescent current of panel in mains fail	0.095A
ROV output	Fused at 500mA with electronic fuse
Sounder outputs	24V Fused at 500mA with electronic fuse
Fault relay contact rating	30VDC 1A Amp maximum
Fire relay contact rating	30VDC 1A Amp maximum
Local fire relay contact rating	30VDC 1A Amp maximum
First stage contact rating	30VDC 1A Amp maximum
Second stage contact rating	30VDC 1A Amp maximum
Extract contact rating	30VDC 1A Amp maximum
Zone quiescent current	2mA maximum
Terminal capacity	12 AWG
Number of detectors per zone	Dependent on type (maximum 32)
NAC rating	0.5A per circuit
Detection circuit end of line	6K %5 8 1/2 Watt resistor
Monitored input end of line	6K %5 8 1/2 Watt resistor

Sounder circuit end of line	10K %5 1/4 Watt resistor
Extinguishant output EOL	1N4004 Diode
No. of initiating circuits	3
No. of NAC circuits	2 x 1st Stage, 1 x 2nd Stage
Extinguishant release output	Fused at 1 Amp
Extinguishant release delay	Adjustable 0 to 60 seconds (in 5 second steps)
Extinguishant release duration	Adjustable 60 to 300 seconds (in 5 second steps)
SIL, AL, FLT, RST inputs	Switched -ve, max resistance 100 Ohms
Zone normal threshold	8K ohms to 1K ohm
Detector alarm threshold	999 ohms to 400 ohms
Call point alarm threshold	399 ohms to 100 ohms
Short circuit threshold	99 ohms to 0 ohms
Monitored inputs normal threshold	8K ohms to 1K ohm
Monitored inputs alarm threshold	999 ohms to 100 ohms
Monitored inputs Short circuit threshold	99 ohms to 0 ohms
Status unit/Ancillary board connection	Two wire RS485 connection
Status unit power output	Fused at 500mA with electronic fuse

PANELS

Product Code	Description	Size (mm)
S115R-EXT	Surface mounting panel - Red 115V	368 x 310 x 90
S230R-EXT	Surface mounting panel - Red 230V	368 x 310 x 90
S115G-EXT	Surface mounting panel - Grey 115V	368 x 310 x 90
S230G-EXT	Surface mounting panel - Grey 230V	368 x 310 x 90